Fluoride in Public Drinking Water Supplies of Missouri

Public Water Systems with levels of Fluoride that exceed 0.6 Mg/L*

*Green labels = natural occurring Fluoride


*Purple labels = Fluoride added


Miles 0 15 30 60


Prepared for the Missouri Department of Health and Senior Services by the Missouri Department of Natural Resources, Water Protection Program.

Missouri Department of Natural Resources


April 2012



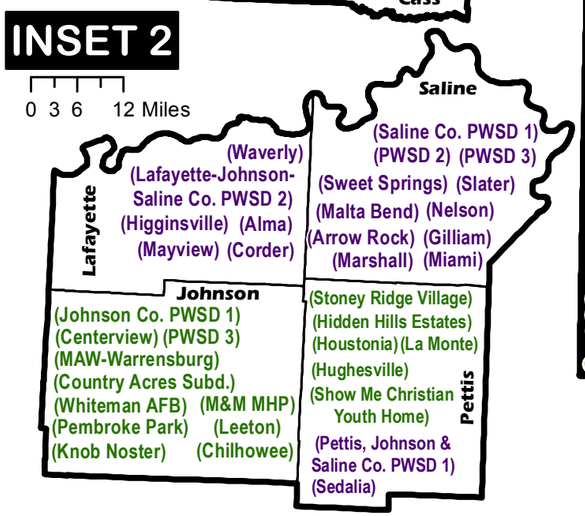

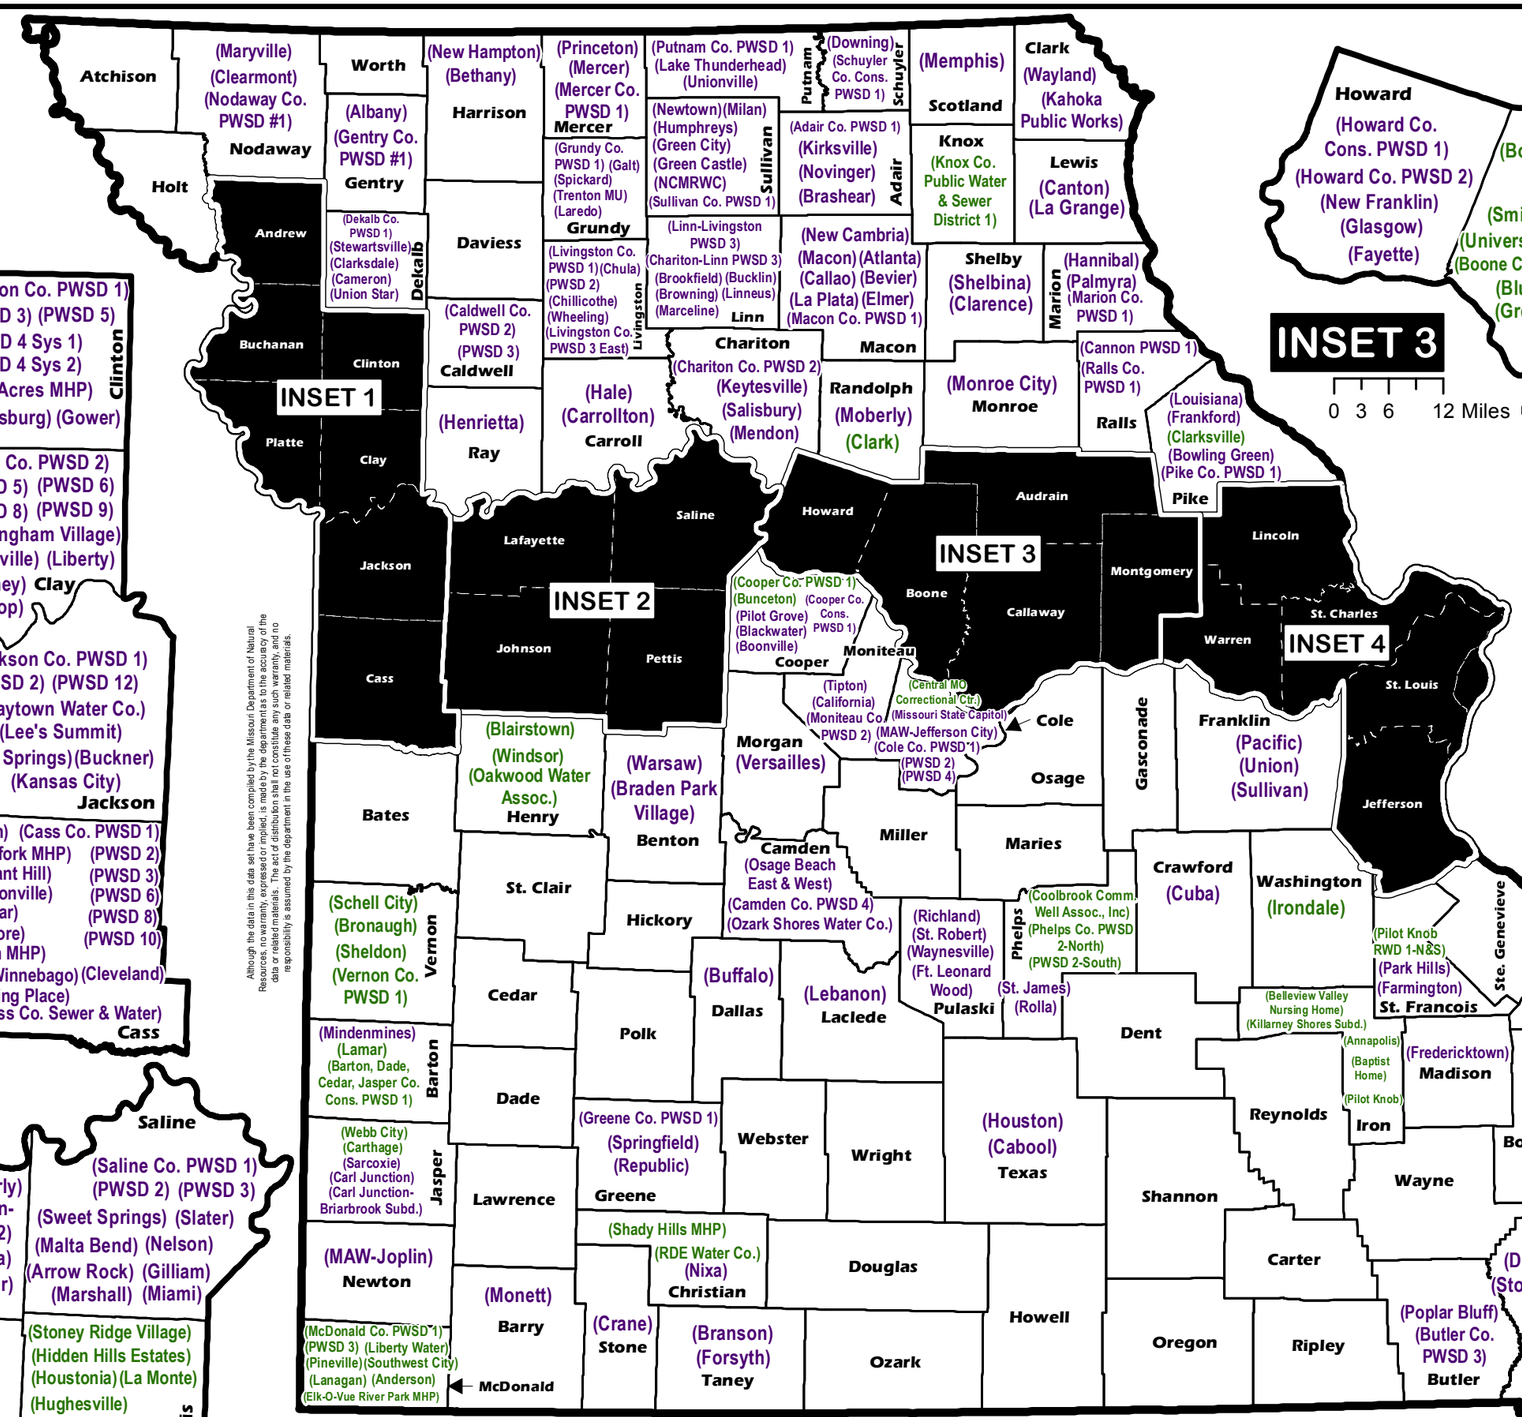





Although the data in this data set have been compiled by the Missouri Department of Natural Resources, no warranty, expressed or implied, is made by the agency as to the accuracy of the data or related materials. The act of distribution shall not constitute any such warranty, and no responsibility is assumed by the department in the use of these data or related materials.

Actual locations of water systems not shown. Systems are labeled within the primary county served. NOTE: Many water systems have service areas that cross county lines - this is particularly true for Public Water Supply Districts. Systems illustrated here represent primary water systems (producers of water) and secondary systems (purchasers of water). The Missouri Department of Natural Resources monitors Fluoride on a revolving three year cycle. Data shown here represents data collected between March 2009 through March 2012. Please contact the Missouri Department of Natural Resources' Public Drinking Water Branch at 573-751-1300 or your local water provider for specific questions about Fluoride concentrations in public water supplies.

PWSD = Public Water Supply District
RWD = Rural Water District
MHP = Mobile Home Park
NCMRWC = North Central MO Reg. Water Comm.
MAW = Missouri American Water